


KNX Gateway: **CTG-IP/KNX**
Catalog-No.: **532001**

1. Establish power connection

100V-240V AC with 25mA

2. Default settings:

IP Address: 192.168.1.213
Subnet mask: 255.255.255.0
Standard gateway: not set
Modus: TCP Server
Port: 10002
Password: not set

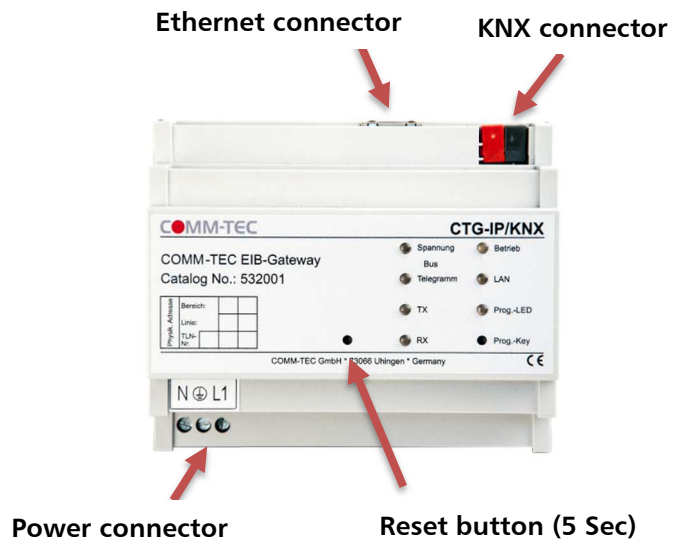

3. Set IP-Adresse:

The IP Address will be configured with **CTG-IP-KNX_Config** software.

4. Simultaneous IP connections

The gateway allows only one simultaneous IP connection

5. Filtertable

Please note: Communication with the EIB-Bus is only possible, if the filtertable of the gateway is configured with the group addresses. Setup of the filtertable can be done via a driver of a media control system or with the **AVIT-Terminal Software**.

6. ETS database

There is no ETS database available and needed.
All Settings will be done with the mediacontrol system.

7. Control protocol

The control protocol is available on our webpage

8. Downloads

All software downloads are available here:
<https://www.comm-tec.de/en/produkte/ctg-ip-knx.html>



Software
download

9. Reset to Factory Default:

Press the left reset button for 5 seconds. Only the IP settings are set back to factory defaults.
Nothing else will be changed.